NOTES:

1. PIPING, NIPPLES, PLUGS & BALL VALVES TO BE 300 SERIES STAINLESS STEEL OR AS NOTED.
2. 36" MINIMUM COVER ON HDPE TUBING TO WITHIN 12" OF PEDESTAL.
3. VALVE SHALL BE INSTALLED WITH A VALVE BOX, COVER, AND MARKER, UNLESS VALVE IS LOCATED IN DITCH, IN WHICH CASE MARKER LOCATING VALVE IS STILL REQUIRED.

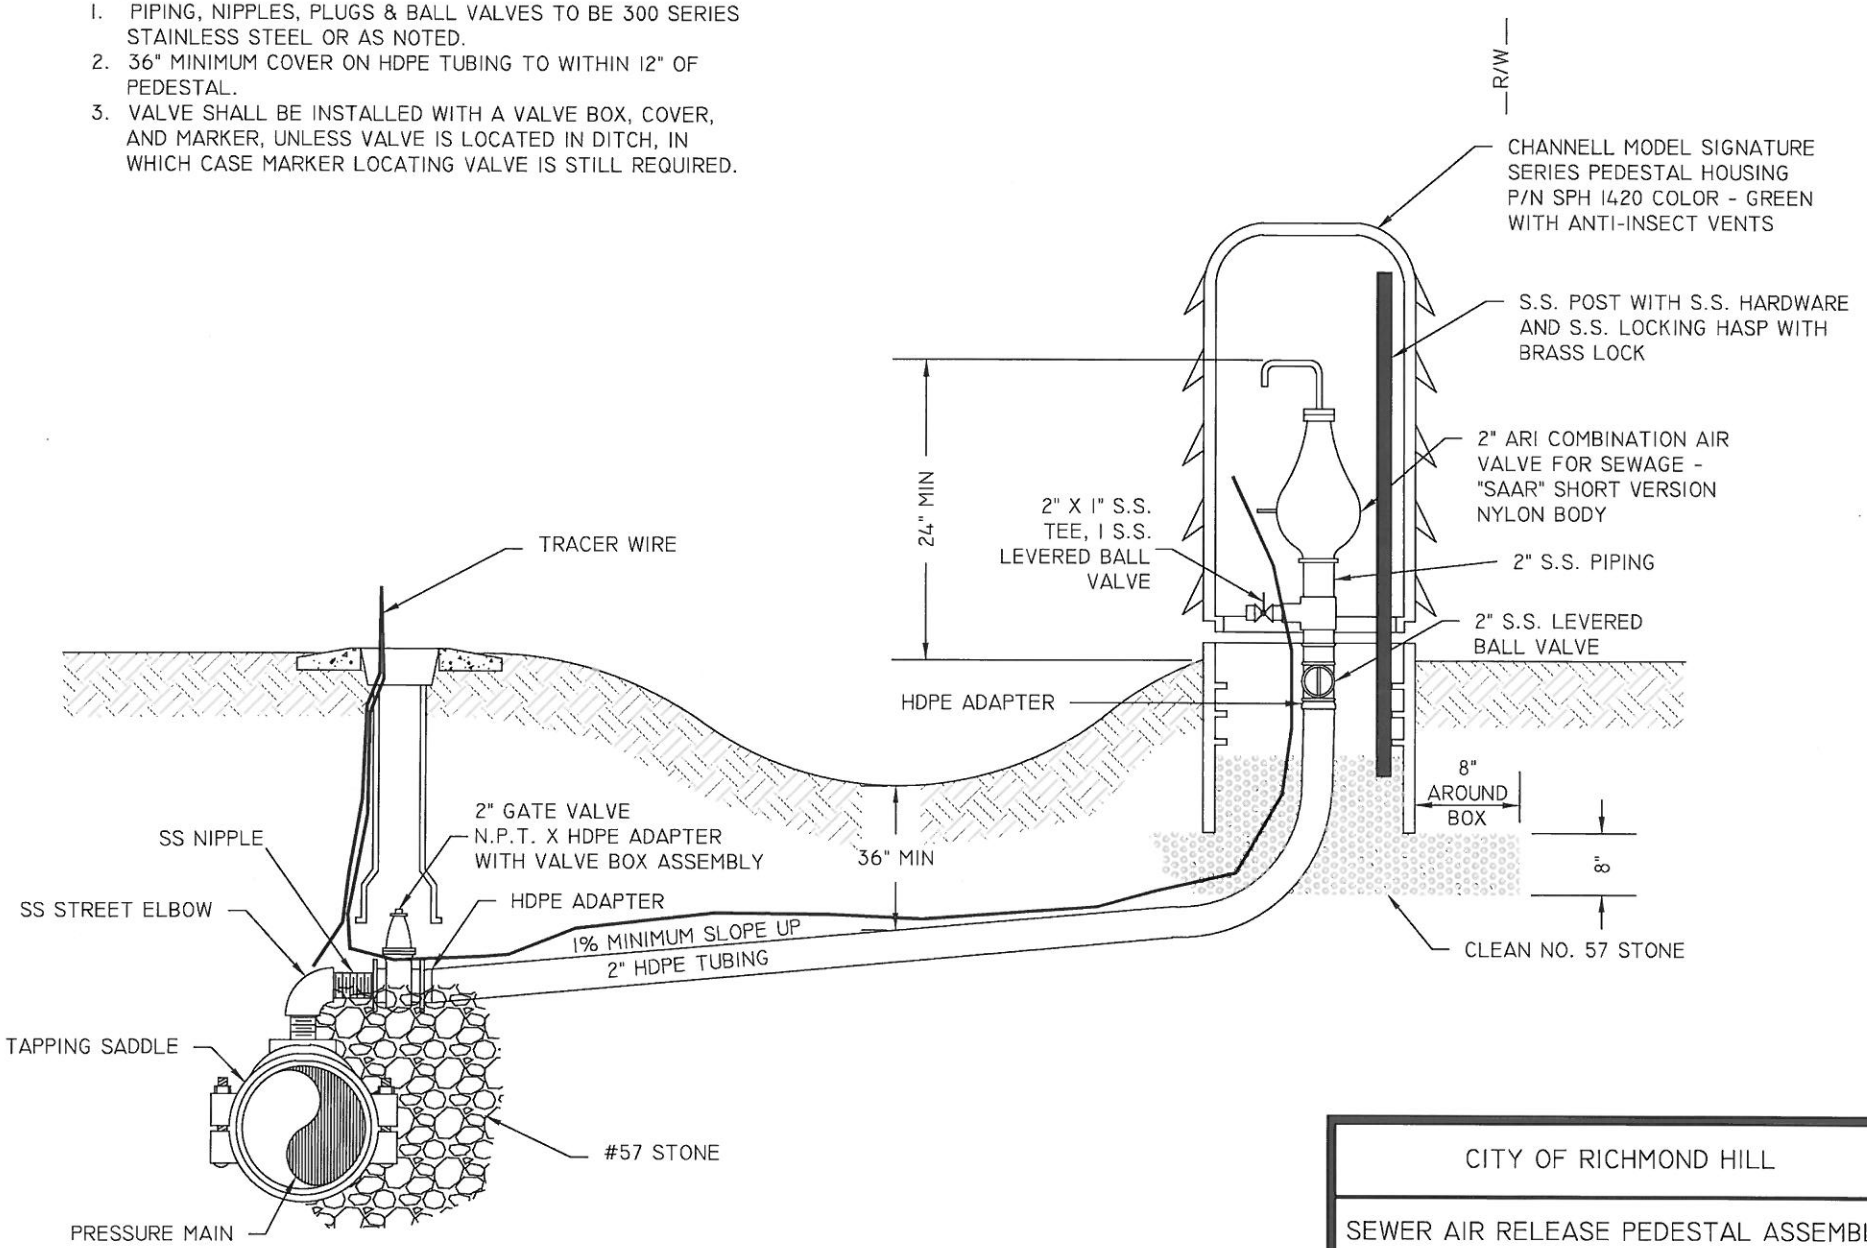

CITY OF RICHMOND HILL		
SEWER AIR RELEASE PEDESTAL ASSEMBLY		
DATE: 01/13/16	DRAWN BY: MCF	DRAWING #: S-6
SCALE: N.T.S.	APPROVED BY: FS	